

Non-Standard Installation Approval Form

FOR OFFICE USE ONLY

TO: Environment Canterbury
 C/o Water Metering Team
 200 Tuam Street
 PO Box 345
 Christchurch 8140

Ph: 03 353 9007
 Email: water.metering@ecan.govt.nz

If a water meter installation can not comply with Environment Canterbury standards, then a request for non-standard installation needs to be submitted. This form needs to be completed and submitted to the relevant compliance section. Please also complete the flow meter data logger installation and commissioning certificate which includes fields for data logger details and accuracy details.

Consent Holder: _____

Consent number: _____ CRC _____

Well/SWAP number(s): _____

Proposed Flowmeter details:

Make: _____


Meter size: _____ (mm diameter)

Model: _____

Pulse output: **Yes / No**

Reason(s) for Non-Standard Installation:

Figure 1: Installation diagram - Please mark any disturbances upstream of the flowmeter e.g. pipe size reduction, gate valves, pipe bends.

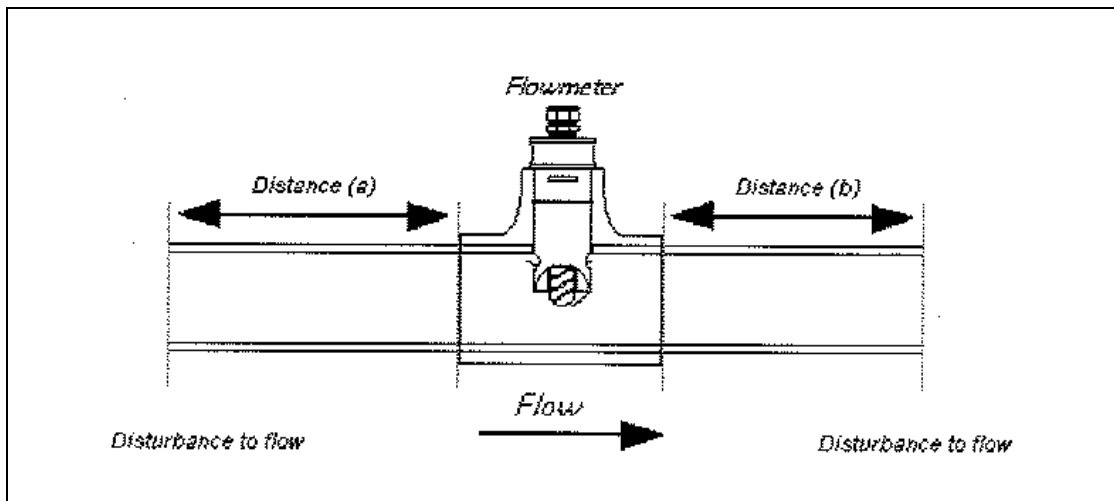

Information to be provided with application:

The following information is to be attached to the application.

- A letter from the meter manufacturer/supplier confirming that the meter will operate within the required accuracy within the non-standard pipe run.
- A picture(s) of the current installation.
- A location map showing where a 15 diameters length of straight unobstructed accessible pipe run is available to verify the system flow with a clamp-on flow meter. The map should show the approximate location of this section of pipe in proximity to the installed water meter.
- Approximate timeline for installation (i.e. when by?). Date: _____

Installer Contact Details:

Company: _____

Contact Person: _____

Email: _____

Phone No: _____

Mobile No: _____

Date: _____